




API PLAN - 12

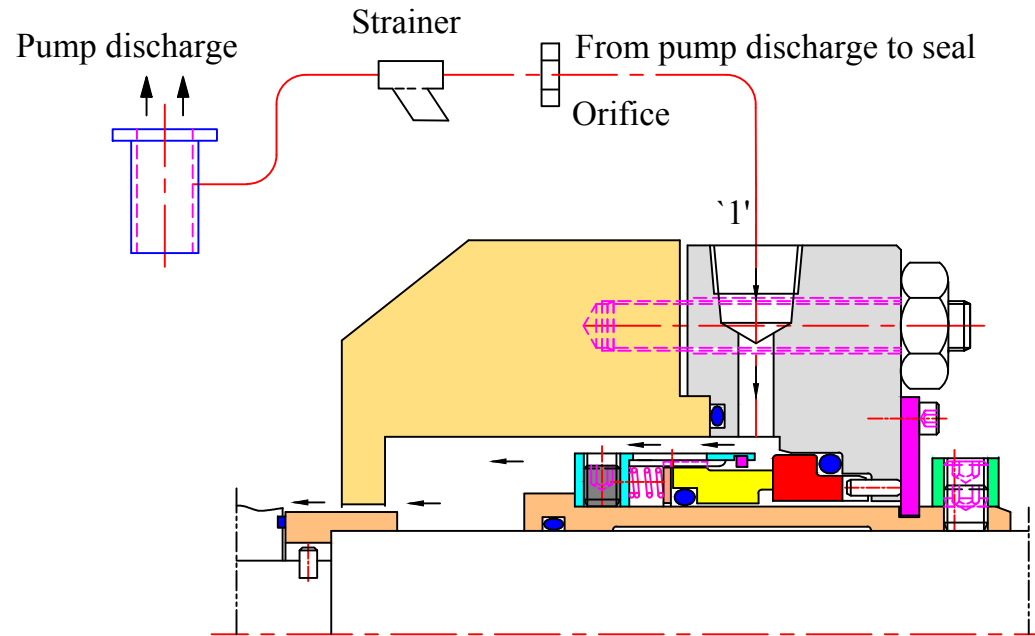

- Recirculation from pump discharge through a strainer and flow control orifice to the seal. This plan is similar to Plan 11 but with the addition of a strainer to remove occasional particles. Strainers are not normally recommended because blockage of the strainer will cause seal failure
- Connection '1' for flushing inlet.
- General applications with clean fluids.
- Clean, non-polymerizing fluids.